
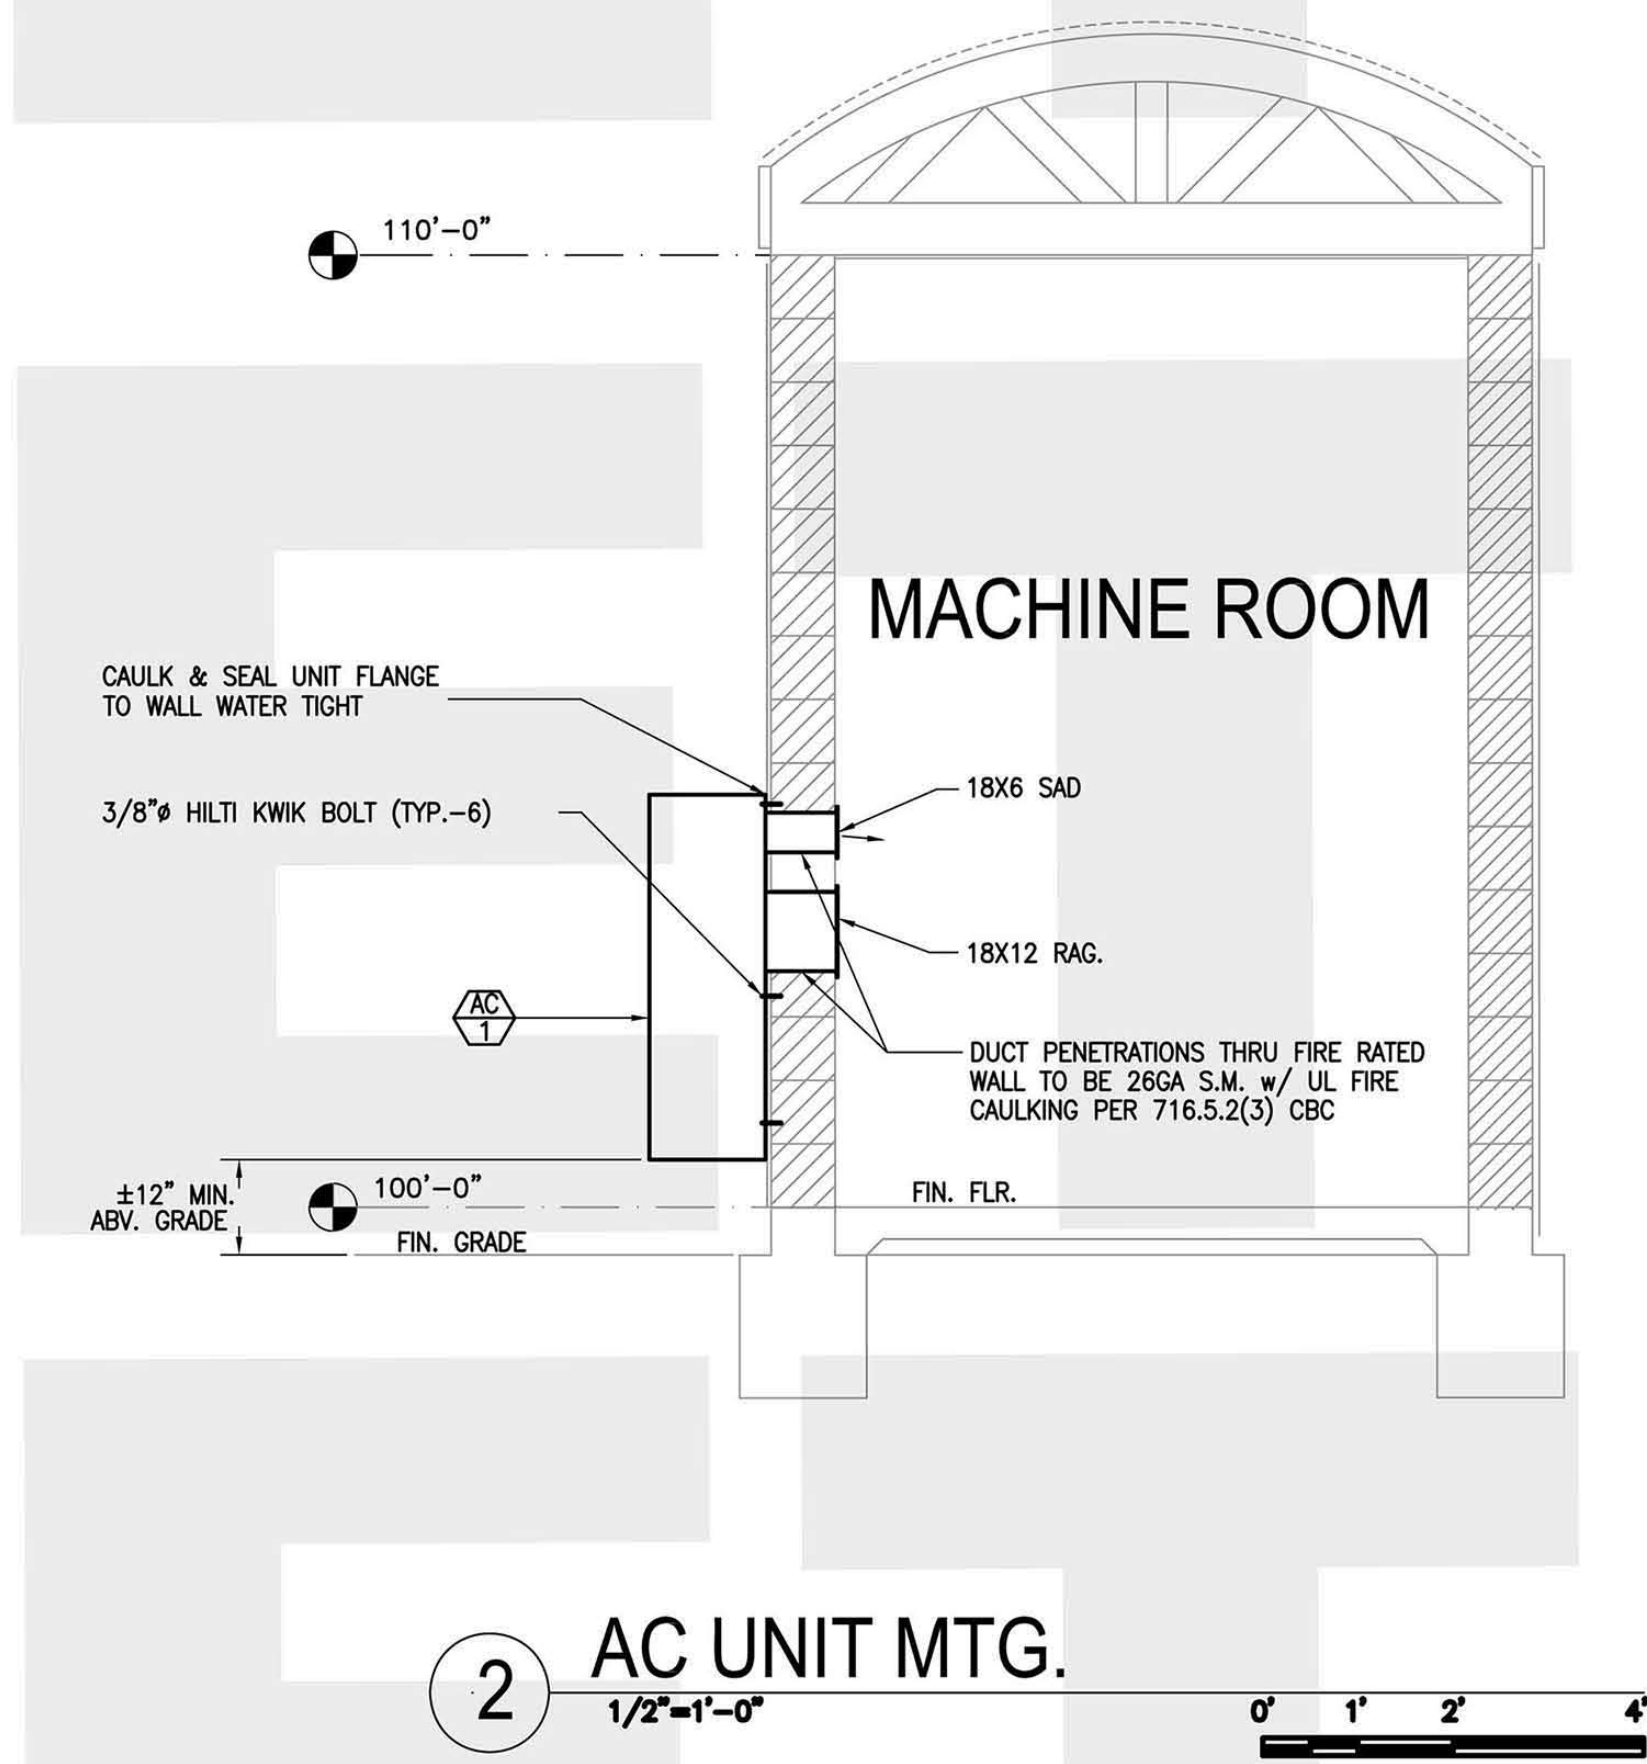


BID
BID
BID
BID
BID
BID
BID

SET
SET
SET
SET
SET
SET
SET

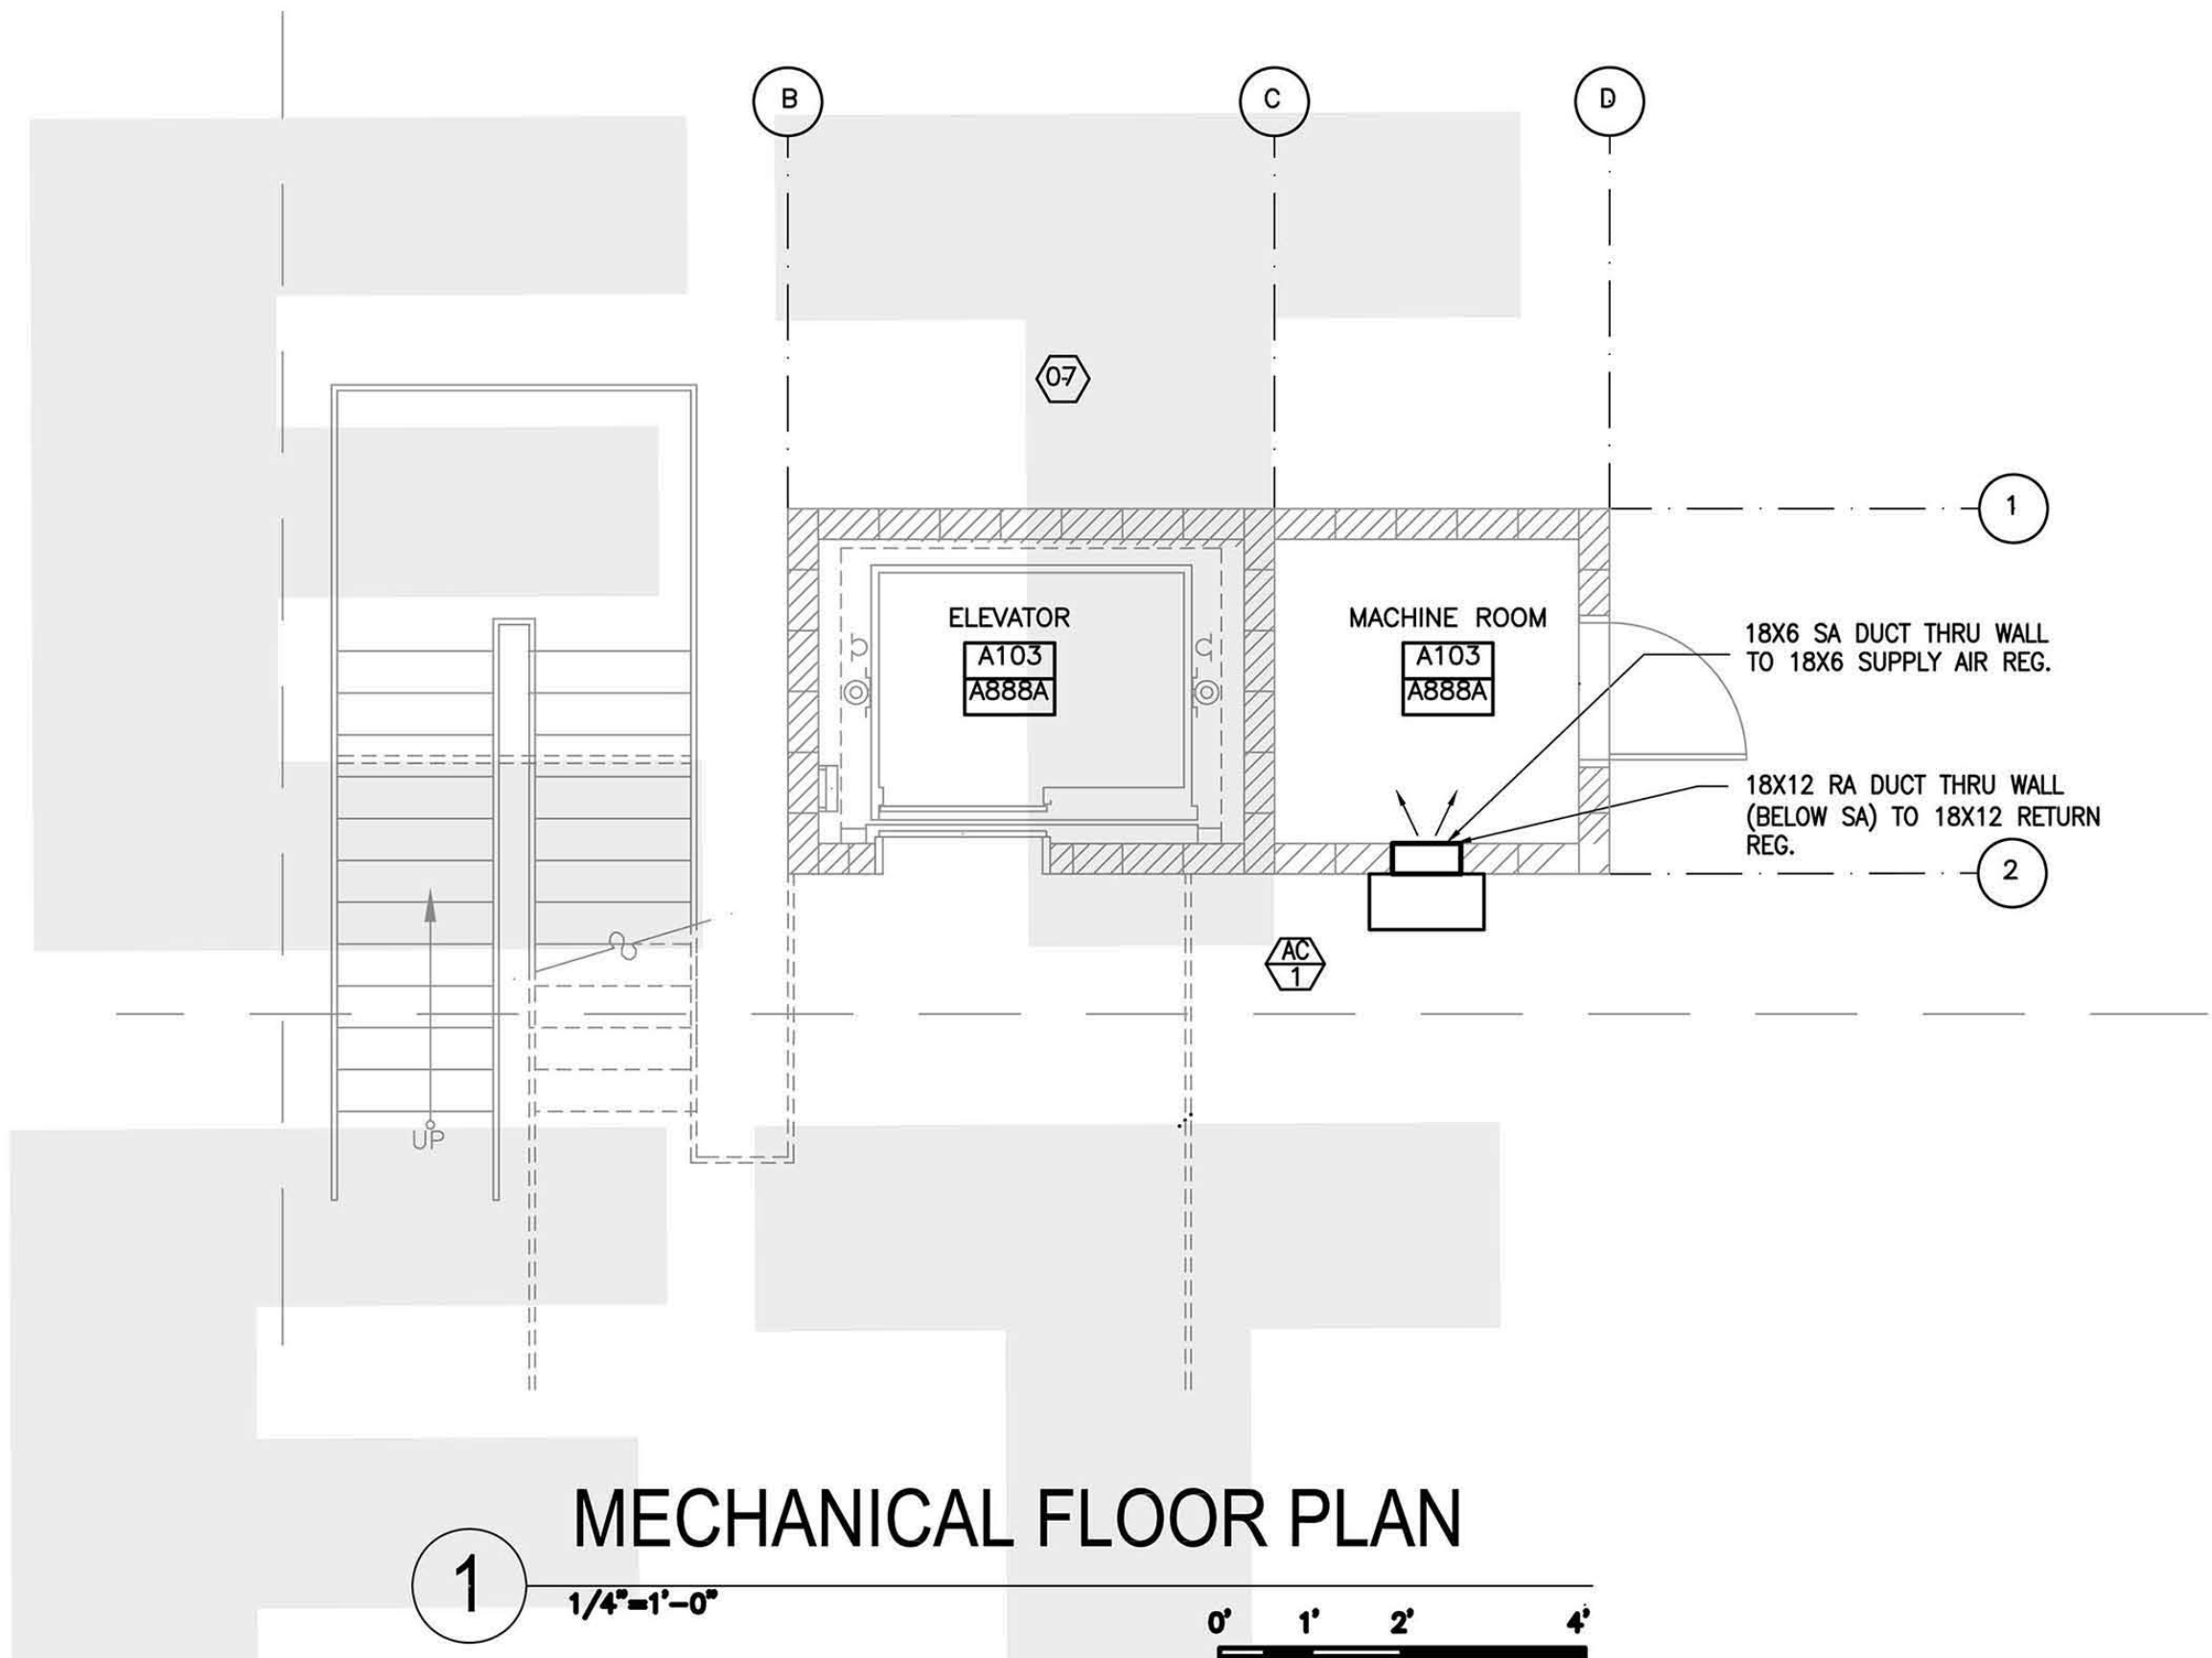

EQUIPMENT SCHEDULE

BARD #W12A1A00BX220U WALL MOUNTED AC UNIT - NOM. 1 TON - BLANK OFF PLATE
1-INCH THROWAWAY FILTER - FACTORY CONTROLS COLOR AS SELECTED BY ARCH. -
CONDENSATE SLINGER - 9.0 MCA @ 208/230V/1 # - 170 LBS

SUPPLY AIR REGISTER - ANEMOSTAT #52HD No.OBD (OR EQUAL)
RETURN AIR REGISTER - ANEMOSTAT #53HD No. OBD (OR EQUAL)

NOTE:
1. ALL DUCTS TO BE GALV. SHEET METAL AS PER CMC.



ELEVATOR BUILDING
ADDITION
FOR:
AJITPAL TIWANA M.D.

2700 'F' STREET
BAKERSFIELD,
CALIFORNIA
93301

NOT FOR
CONSTRUCTION

SHEET TITLE

SHEET IDENTIFICATION NUMBER

M-1
SHEET OF