








SEWER PLAN

SEWER PLAN NOTES

- ANY EQUIPMENT DISCHARGING LIQUID WASTE SHALL DRAIN TO A FLOOR SINK VIA LEGAL AIR GAP.
- FLOOR SINKS SHALL BE INSTALLED FLUSH WITH THE FLOOR SURFACE AND BE LOCATED SO AS TO BE READILY ACCESSIBLE FOR CLEANING AND REPAIR.
- PROVIDE AN APPROVED INTEGRAL ATMOSPHERIC VACUUM BREAKER FAUCET FOR MOP SINK.
- ANY EQUIPMENT DISCHARGING LIQUIDWASTE SHALL DRAIN TO A FLOOR DRAIN
- FLOOR SINKS SHALL BE FLUSH WITH FLOOR AND ACCESSIBLE FOR CLEANING AND REPAIR
- PROVIDE A FAUCET WITH VACUUM BREAKER AT MOP SINK (AMERICAN STANDARD, MODEL NUMBER 8341-076 OR SIMILAR

KEYED NOTES:

- 1 1/2" VENT THRU ROOF
- 2" VENT THRU ROOF
- 3" VENT THRU ROOF.
- INSTALL FLOOR CLEAN OUT
- INSTALL TRAP PRIMER FOR FLOOR DRAIN
- 3/4" PVC CONDENSATE DRAIN LINE FROM COILS. HOLD LINES 1" OFF WALLS WITH PIPE SUPPORTS. LINES TO SLOPE AT 1/2" PER FOOT DROP INSIDE COOLER AND EXIT COOLER/FREEZER AT 6" A.F.F. ELECTRICAL CONTRACTOR IS TO WRAP CONDENSATE LINE WITH HEAT TAPE AND PLUMBING CONTRACTOR IS TO WRAP WITH INSULATION INSIDE COOLER ONLY.
- 500 GALLON CAPACITY GREASE INTERCEPTOR, SEE DETAIL. REFER TO CIVIL DRAWINGS FOR EXACT LOCATION.
- INSTALL Y CLEANOUT SEE DETAIL 1 ON THIS SHEET.
- INSTALL CLEANOUT TO GRADE. SEE DETAIL 2 ON THIS SHEET

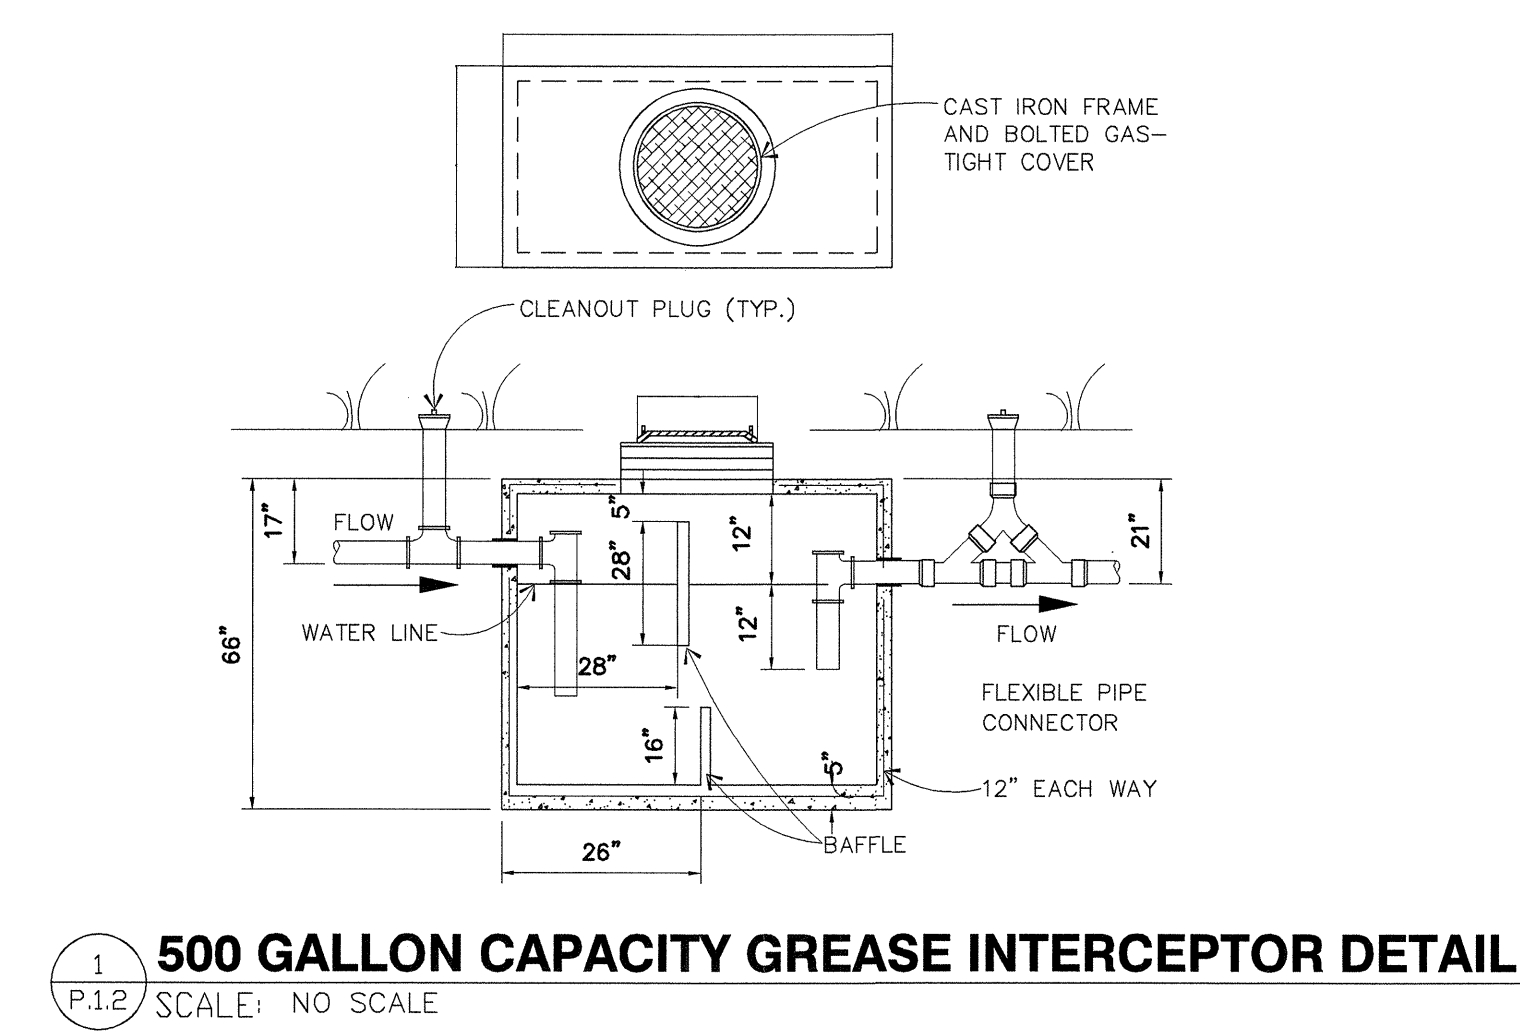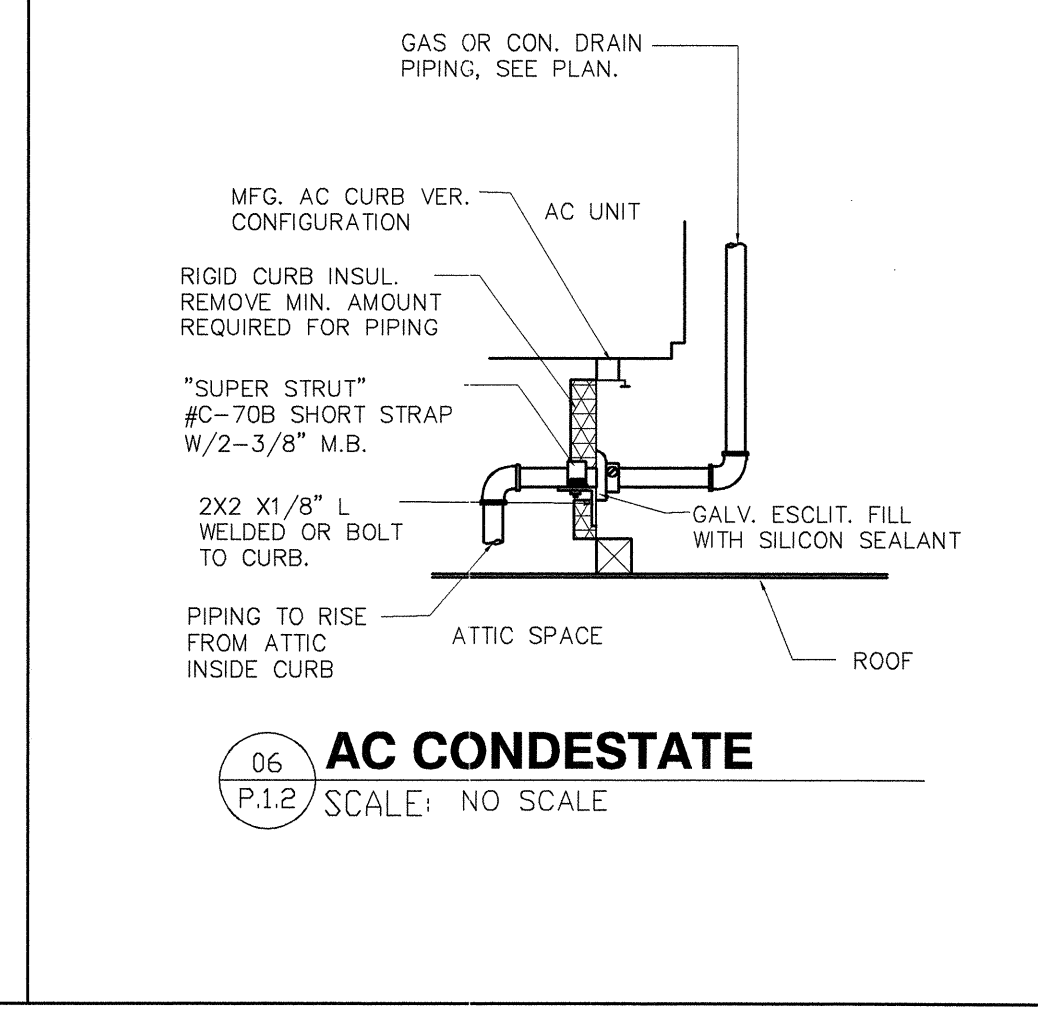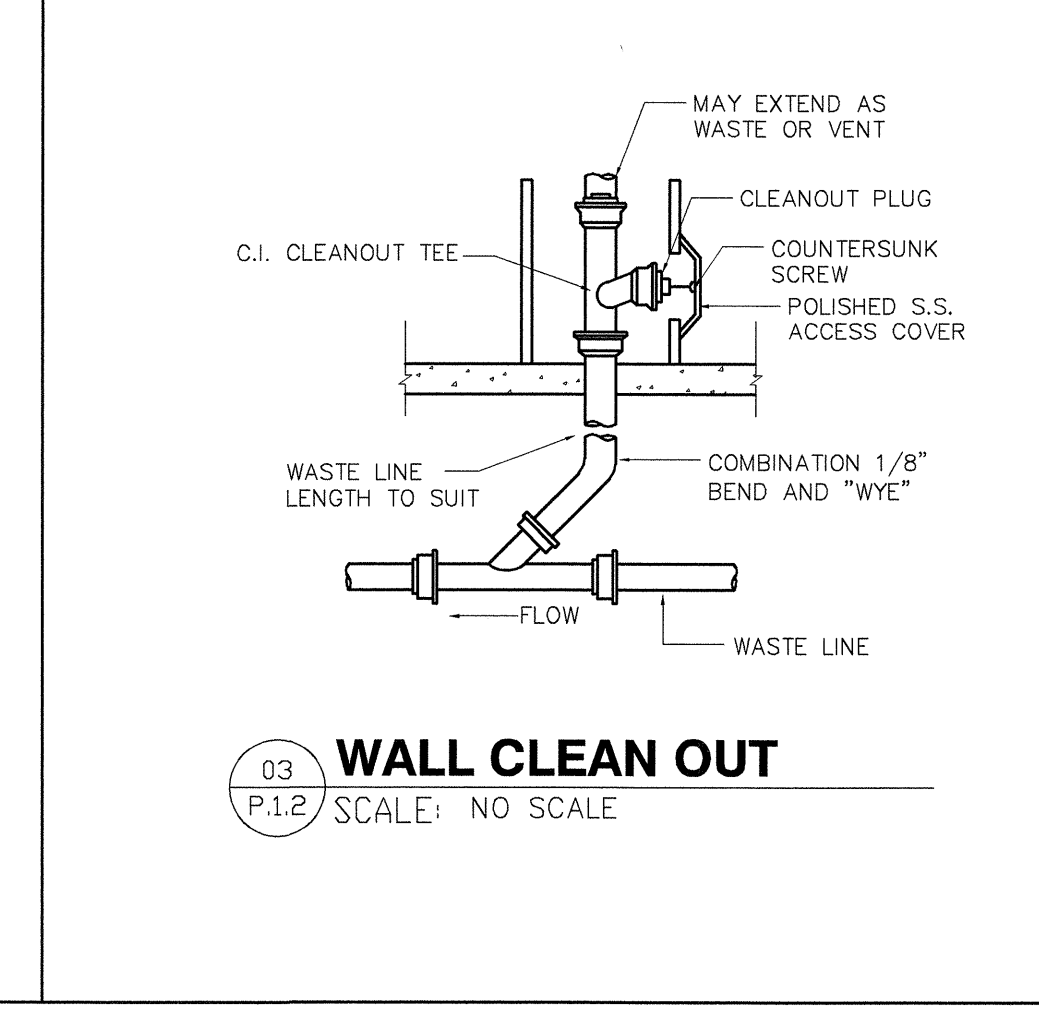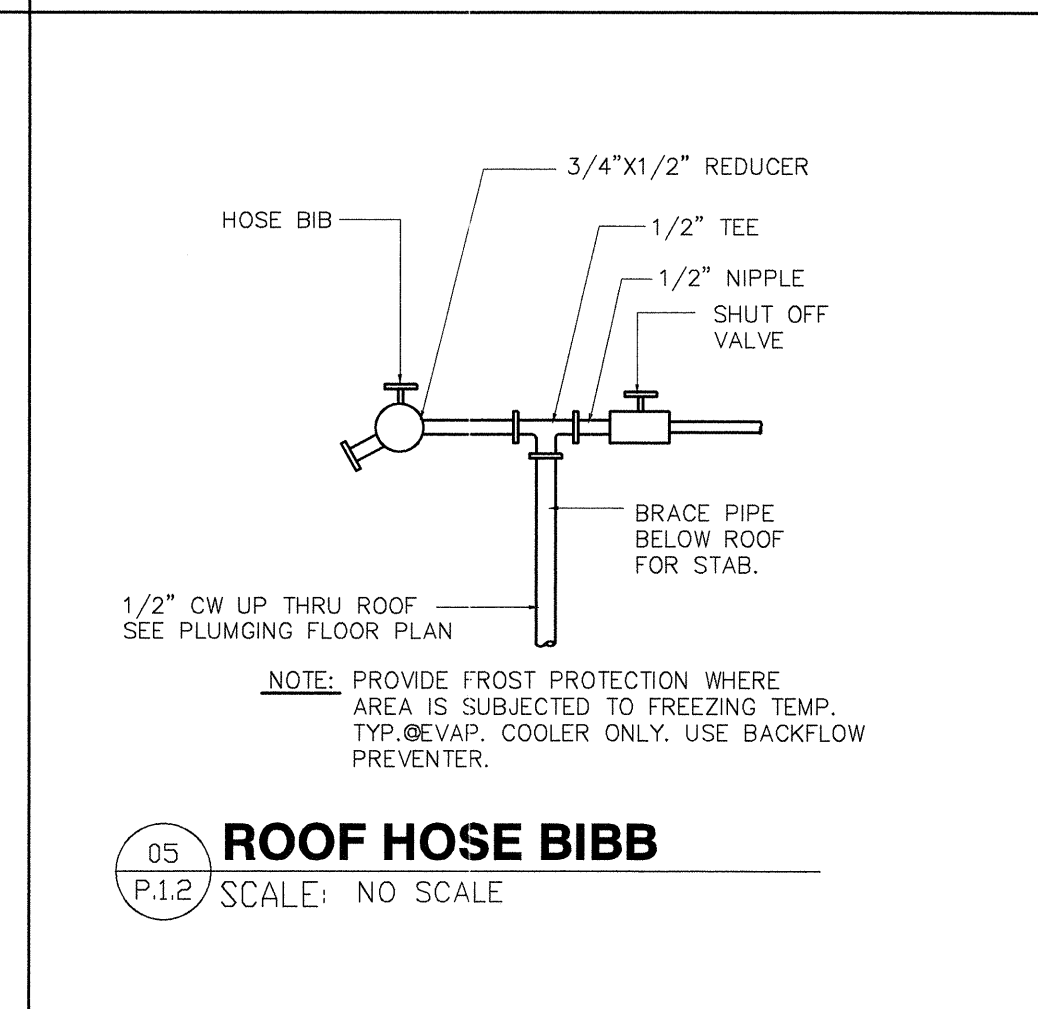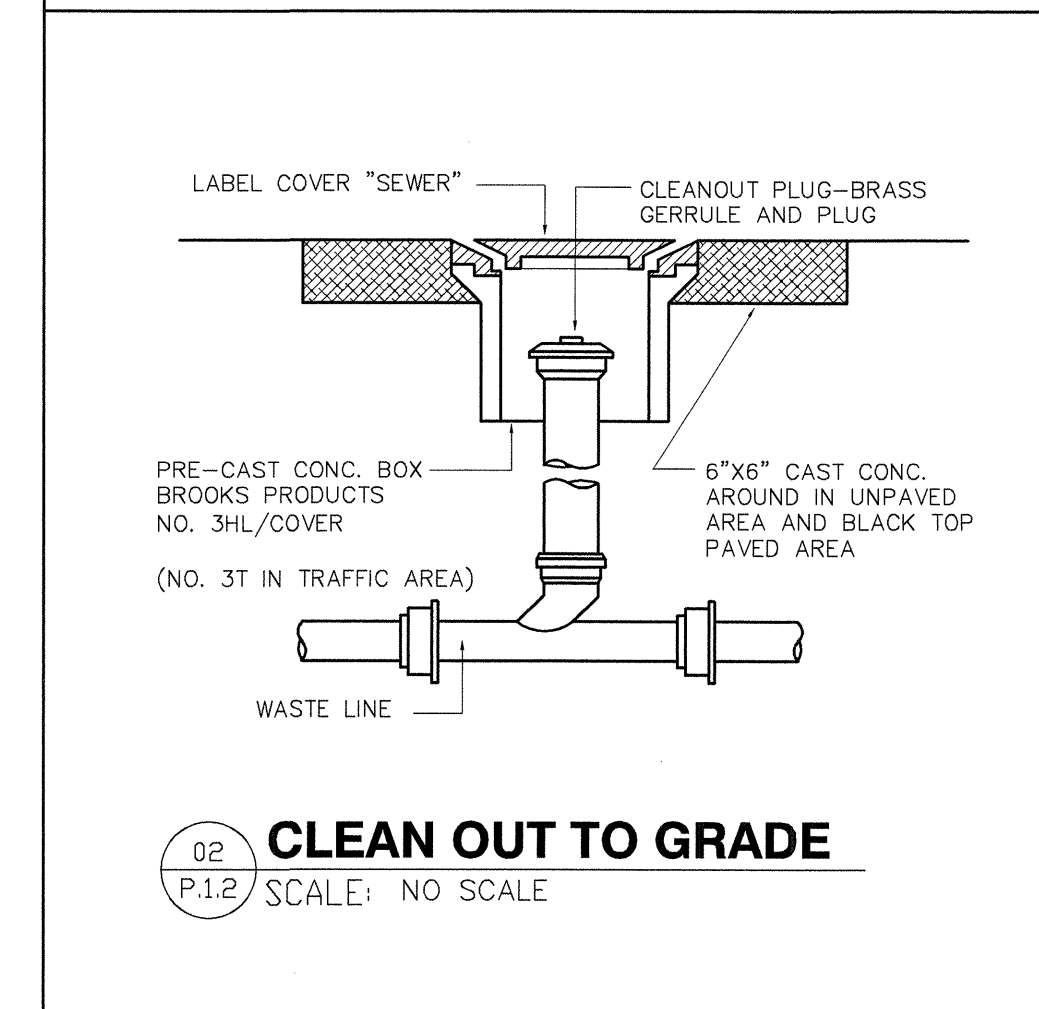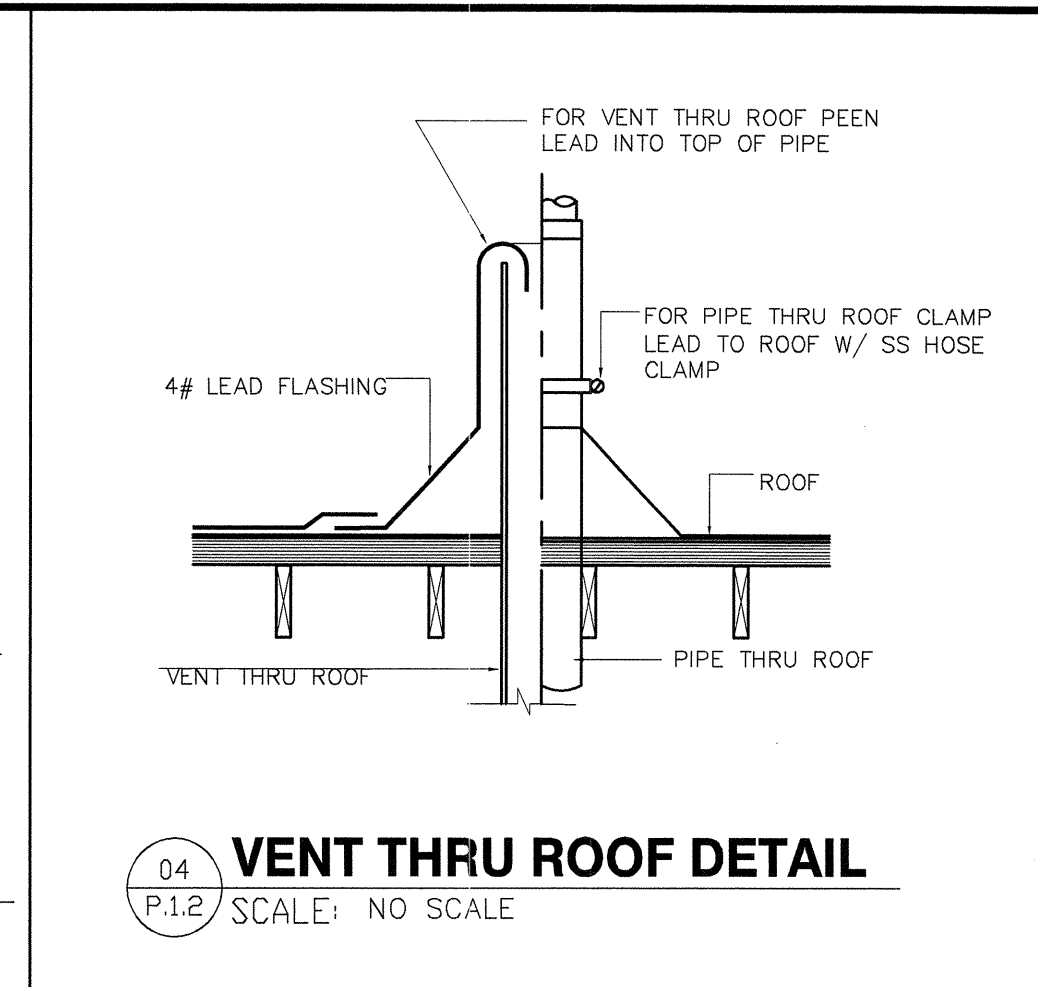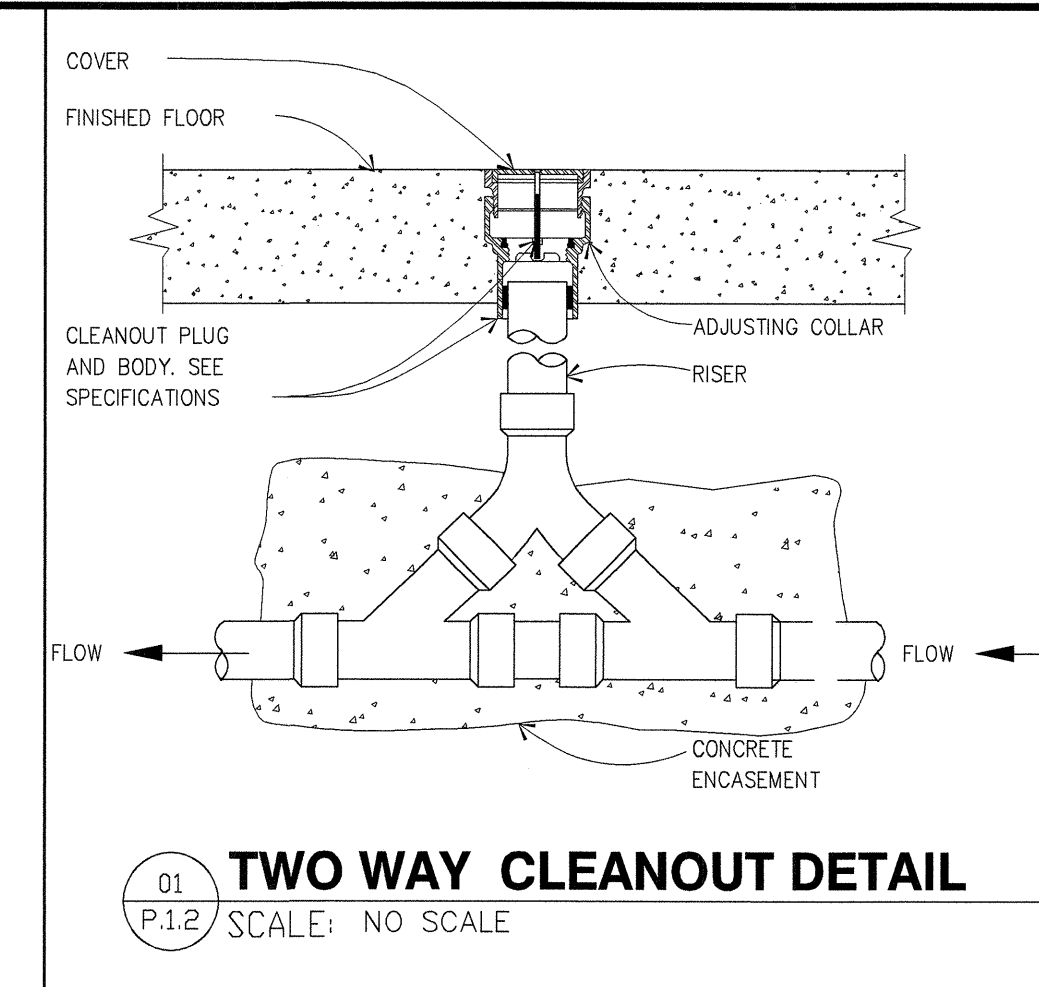

NOTES:

A. CONTRACTOR TO VERIFY REQUIRED INTERCEPTOR CONSTRUCTION METHOD (CAST IN PLACE OR PRE-FAB) WITH LOCAL SANITATION AUTHORITY.

B. PROVIDE CLEANOUTS BEFORE, AND AFTER GREASE INTERCEPTOR.

C. WALLS, TOP, AND BOTTOM SHALL BE 4" THICK CONCRETE WITH #5 RODS, 6" ON CENTER EACH WAY.

D. PRECAST UNITS MAY BE INSTALLED, PROVIDED THEY ARE CONSTRUCTED IN ACCORDANCE WITH ALL APPLICABLE CODES AND PIPING IS AS SHOWN ON THIS DETAIL.

E. FIELD VERIFY EXACT LOCATION FOR GREASE INTERCEPTOR AND COORDINATE INSTALLATION WITH ALL OTHER TRADES.

GENERAL CONTRACTOR TO VERIFY GREASE INTERCEPTOR IS REQUIRED BY WATER AUTHORITY BEFORE INSTALLATION.

REV	DATE/DESC

THESE PLANS PREPARED UNDER THE DIRECT SUPERVISION OF:

**1129 Union Avenue
Bakersfield, Ca**

Sewer Plan

Afinar
civil engineers/surveyors/planners/construction managers
www.afinar.net
2005 Eye Street, Suite 3
Bakersfield, CA 93301
phone (866) 716-7443
fax (866) 716-7444

DATE:	03-26-09
SCALE:	AS NOTED
DRAWN:	AA/LJF
JOB NO:	0734

P-20